



TWIN HEAT MODULE CONNECTION

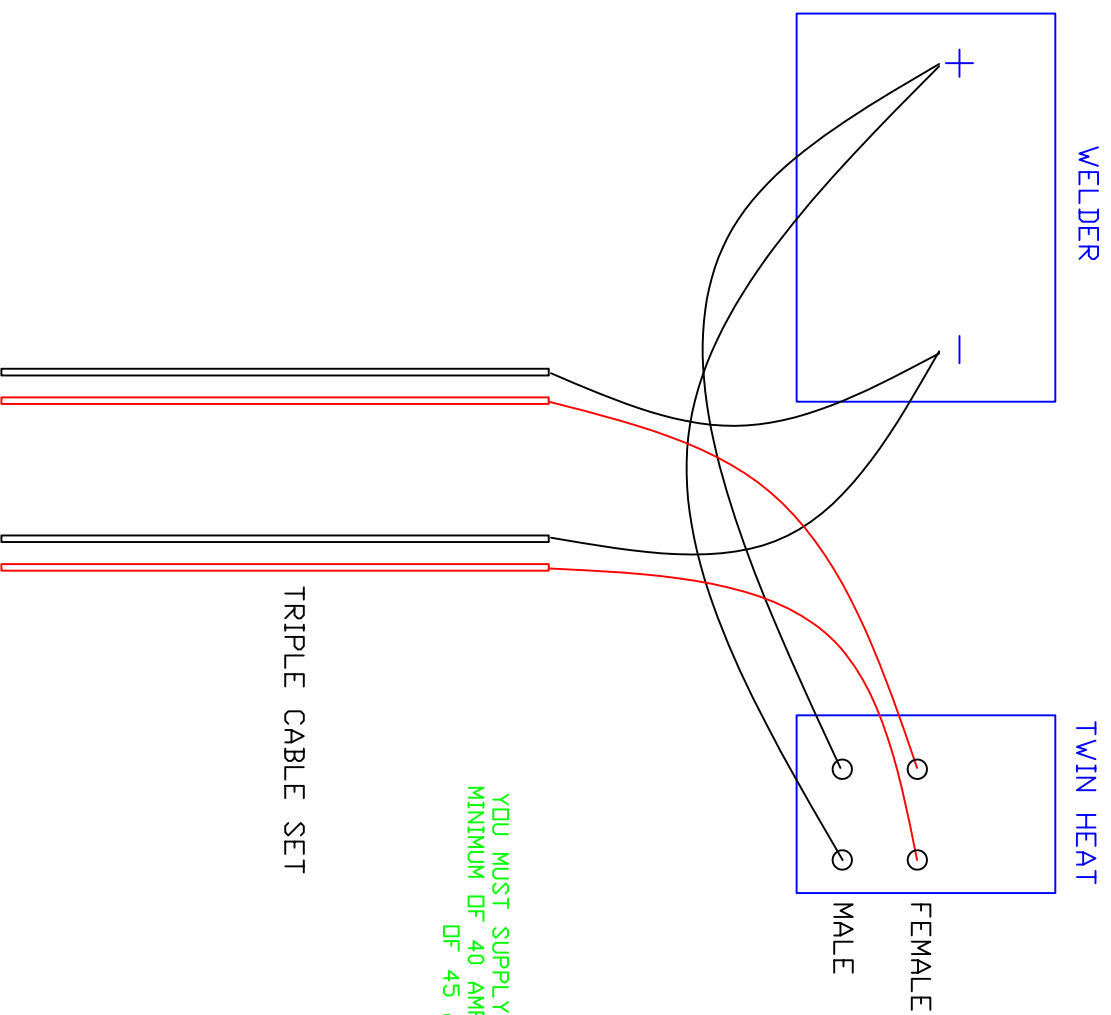

YOU MUST SUPPLY EACH HEATER A
MINIMUM OF 40 AMPS AND A MAXIMUM
OF 45 AMPS

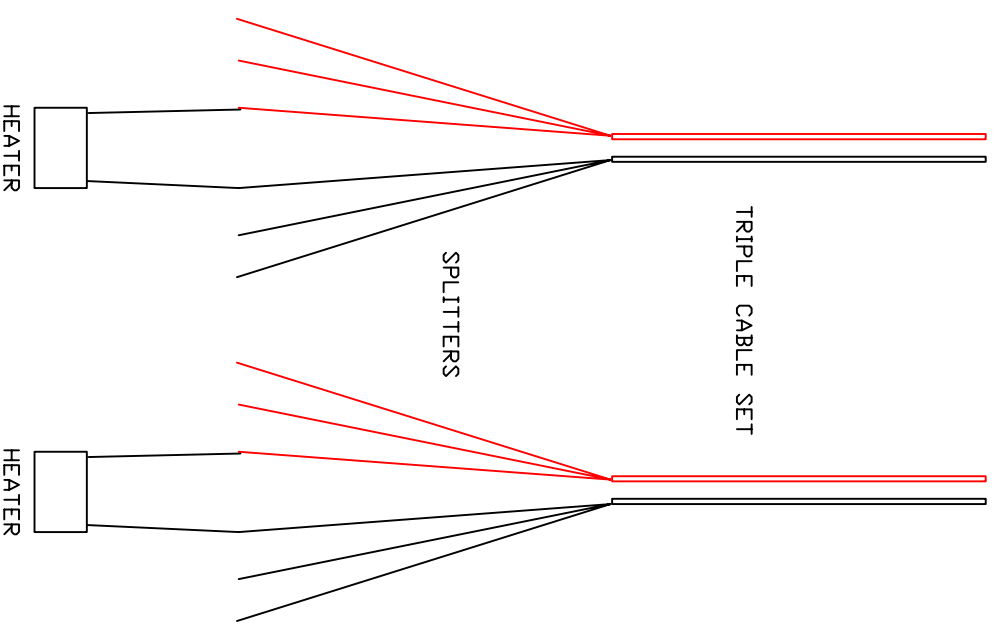

ELECTRIC HEATING SYSTEMS
109 NORTH GOLD DRIVE
ROBBINSVILLE, NJ 08691
609.259.4116